


Electrical Inspections

Solar Installation

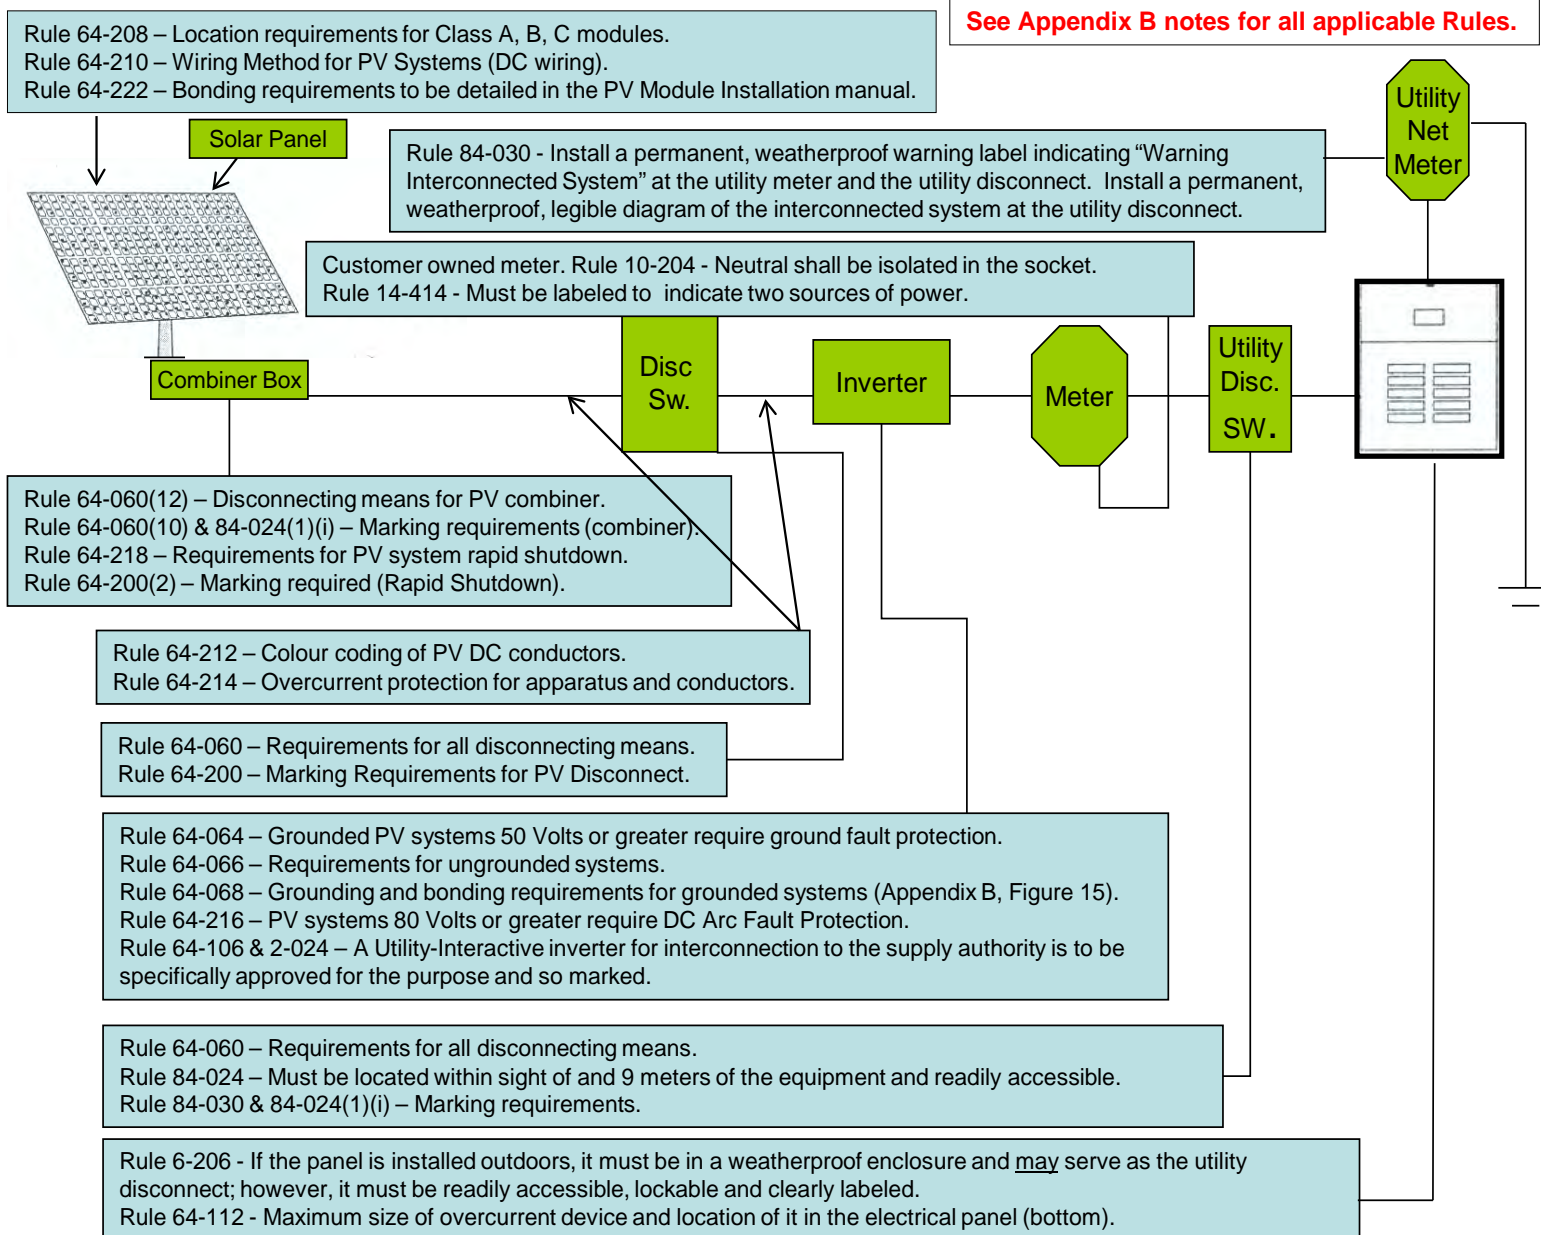

- Note:**
1. All the required labels and diagrams **must** be installed **before** the installation will be approved. All labels and diagrams installed outdoors and exposed to the weather shall meet the requirements listed in the Saskatchewan Interpretations under Rules 64-072, 64-074, & 64-200 for marking, warning labels, notices and diagrams.
 2. All wiring must be done by a licensed Saskatchewan Electrical Contractor and be covered by an appropriate electrical permit. Homeowner Permits are not allowed.
 3. It is the responsibility of the Electrical Contractor to arrange for an inspection 2 weeks prior to requesting a network service connection.
 4. When Network Metering is installed, the Local Utility must approve all connection diagrams **before** the installation begins.
 5. **All renewable energy installations require electrical construction plans to be submitted to Electrical Inspections and reviewed before approval will be granted. See Rule 2-014.**