


CODETTE TO TOBIN LAKE - TRANSMISSION ROUTES

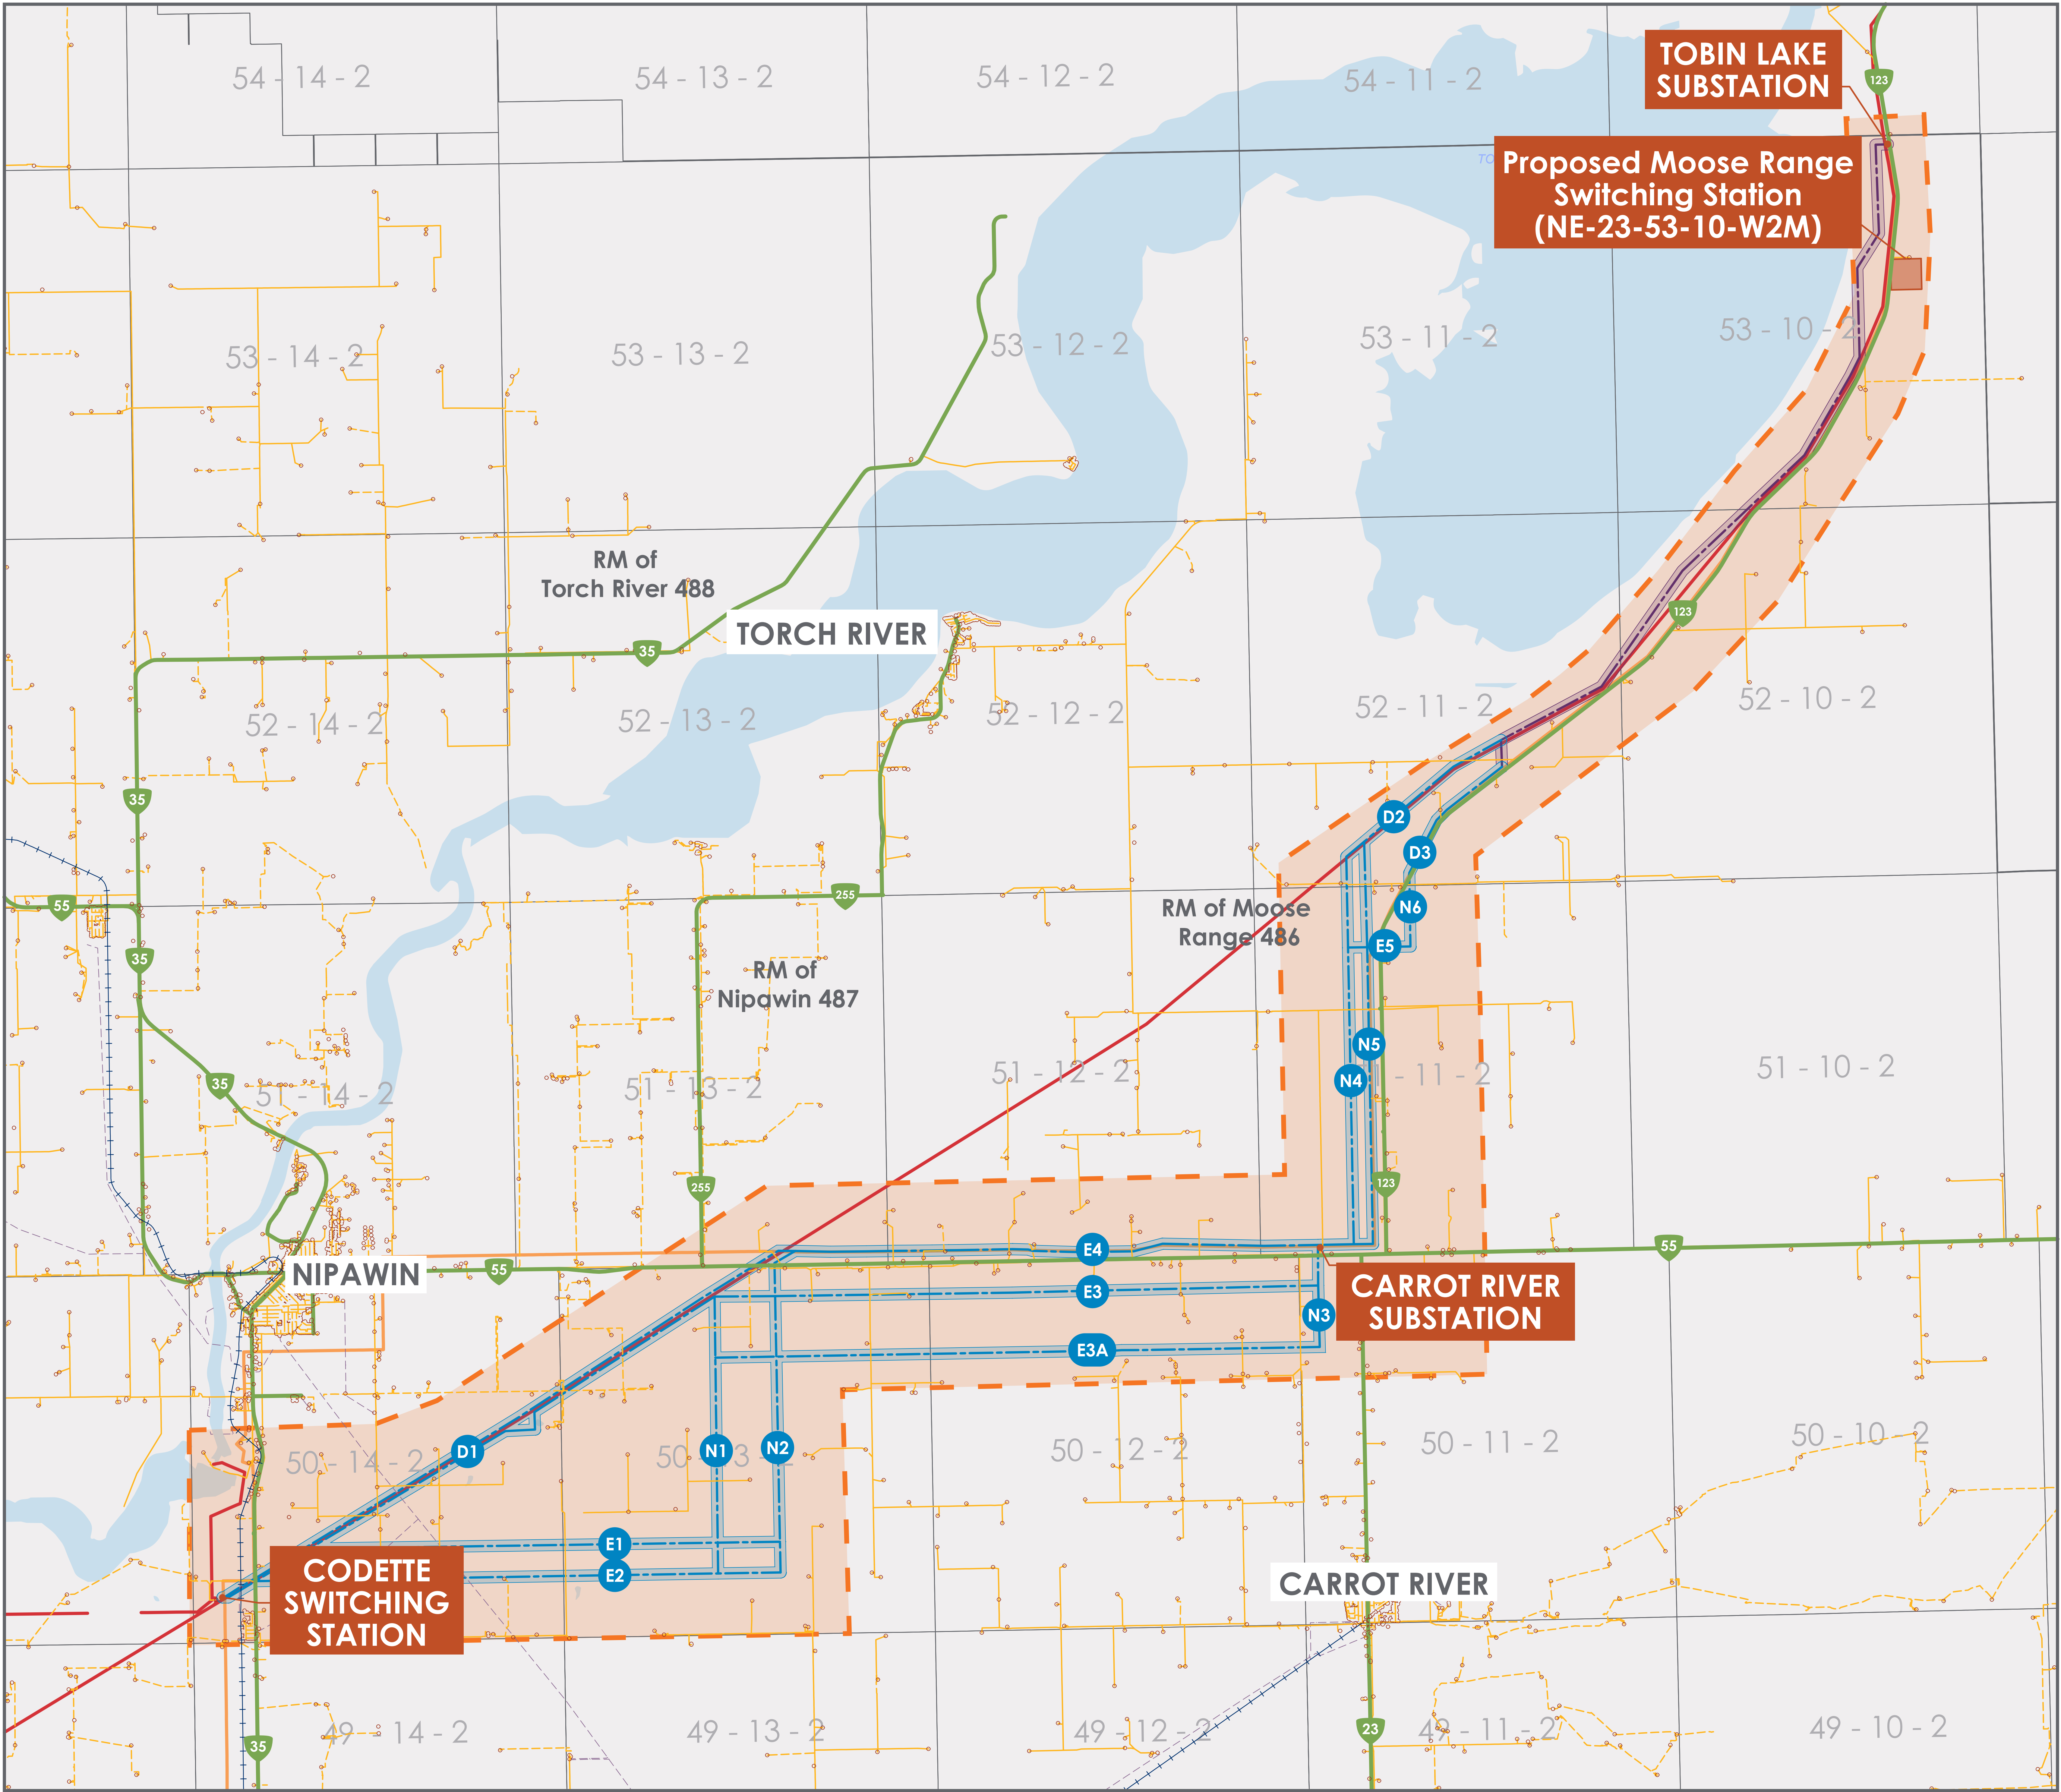

Transmission Routes

- Study Area
- Proposed Route Alternative - Phase 1
- Proposed Transmission Corridor - Phase 1 (300m)
- Proposed Route Alternative - Phase 2
- Proposed Transmission Corridor - Phase 2 (300m)
- Proposed Moose Range Switching Station

Existing Infrastructure

- 230kV Transmission Line
- 72kV Transmission Line
- Overhead Distribution Line
- Underground Distribution Line
- Pipeline

Topology

- Railway
- Highway

Constraints

- House Buffer