


- SASKPOWER**
- EXISTING 230kV TRANSMISSION LINE
  - EXISTING 138kV TRANSMISSION LINE
  - EXISTING 72kV TRANSMISSION LINE
  - PWR-PRIM EXISTING OVERHEAD DISTRIBUTION
  - EXISTING UNDERGROUND DISTRIBUTION
  - EXISTING SPC LAND
  - STUDY AREA
  - PROPOSED ROUTE ALTERNATIVE - PHASE 1
  - PROPOSED TRANSMISSION CORRIDOR - PHASE 1 (300m)
  - PROPOSED ROUTE ALTERNATIVE - PHASE 2
  - PROPOSED TRANSMISSION CORRIDOR - PHASE 2 (300m)
  - PROPOSED MOOSE RANGE SWITCHING STATION

- OTHER UTILITIES**
- EXISTING PIPELINE

- TOPOLOGY**
- RAILWAY
  - RURAL MUNICIPALITY / URBAN MUNICIPALITY
  - HIGHWAY


- CONSTRAINTS**
- ENVIRONMENTAL CONSTRAINTS
  - HOUSE BUFFER - 46m

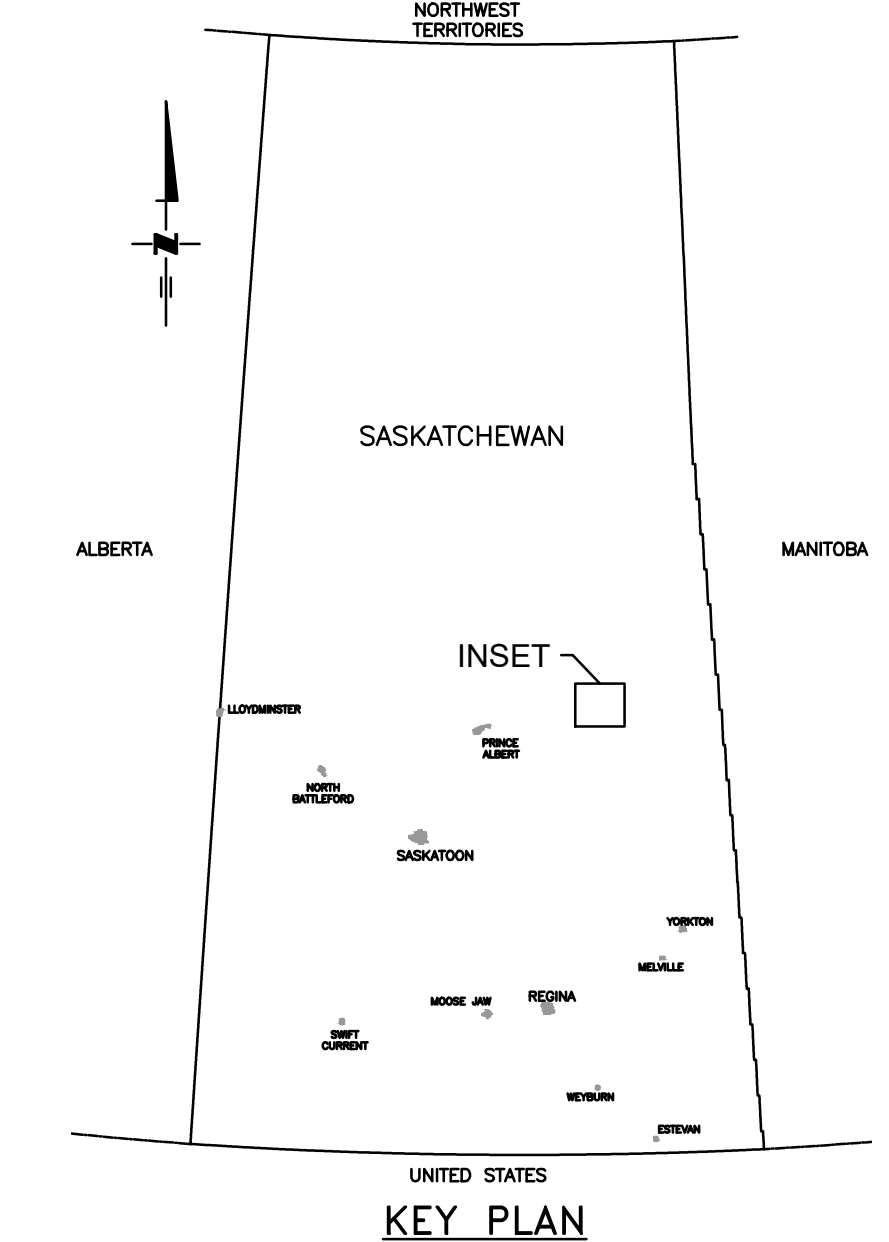


IMAGERY INFO:  
SIC ORTHOPHOTO 60cm RESOLUTION  
COLLECTED: 2009 AUGUST 09  
MAP PROJECTION:  
NAD83 (CSRS) / UTM ZONE 13N

**DISCLAIMER**  
THIS DRAWING WAS PREPARED FOR SASKATCHEWAN POWER CORPORATION ("SaskPower") FOR ITS SPECIFIC INTERNAL PURPOSES ONLY. SaskPower DOES NOT WARRANT THAT THE DRAWING IS COMPLETE, ACCURATE OR CORRECT, NOR DOES IT WARRANT THAT THE DRAWING IS REPRESENTATIVE OF MATTERS DEPICTED THEREIN AS AT THE DATE OF THE REPRESENTATIONS OR WARRANTIES WITH REGARD TO THE ADEQUACY OR SUITABILITY OF THIS DRAWING FOR ANY PURPOSE WHATSOEVER.

SaskPower SHALL NOT BE RESPONSIBLE OR LIABLE TO ANY PERSON IN RESPECT OF ANY LOSS, DAMAGE OR INJURY WHETHER DIRECT OR INDIRECT, ARISING OUT OF THE USE OF OR RELIANCE ON THIS DRAWING, IN WHOLE OR IN PART.

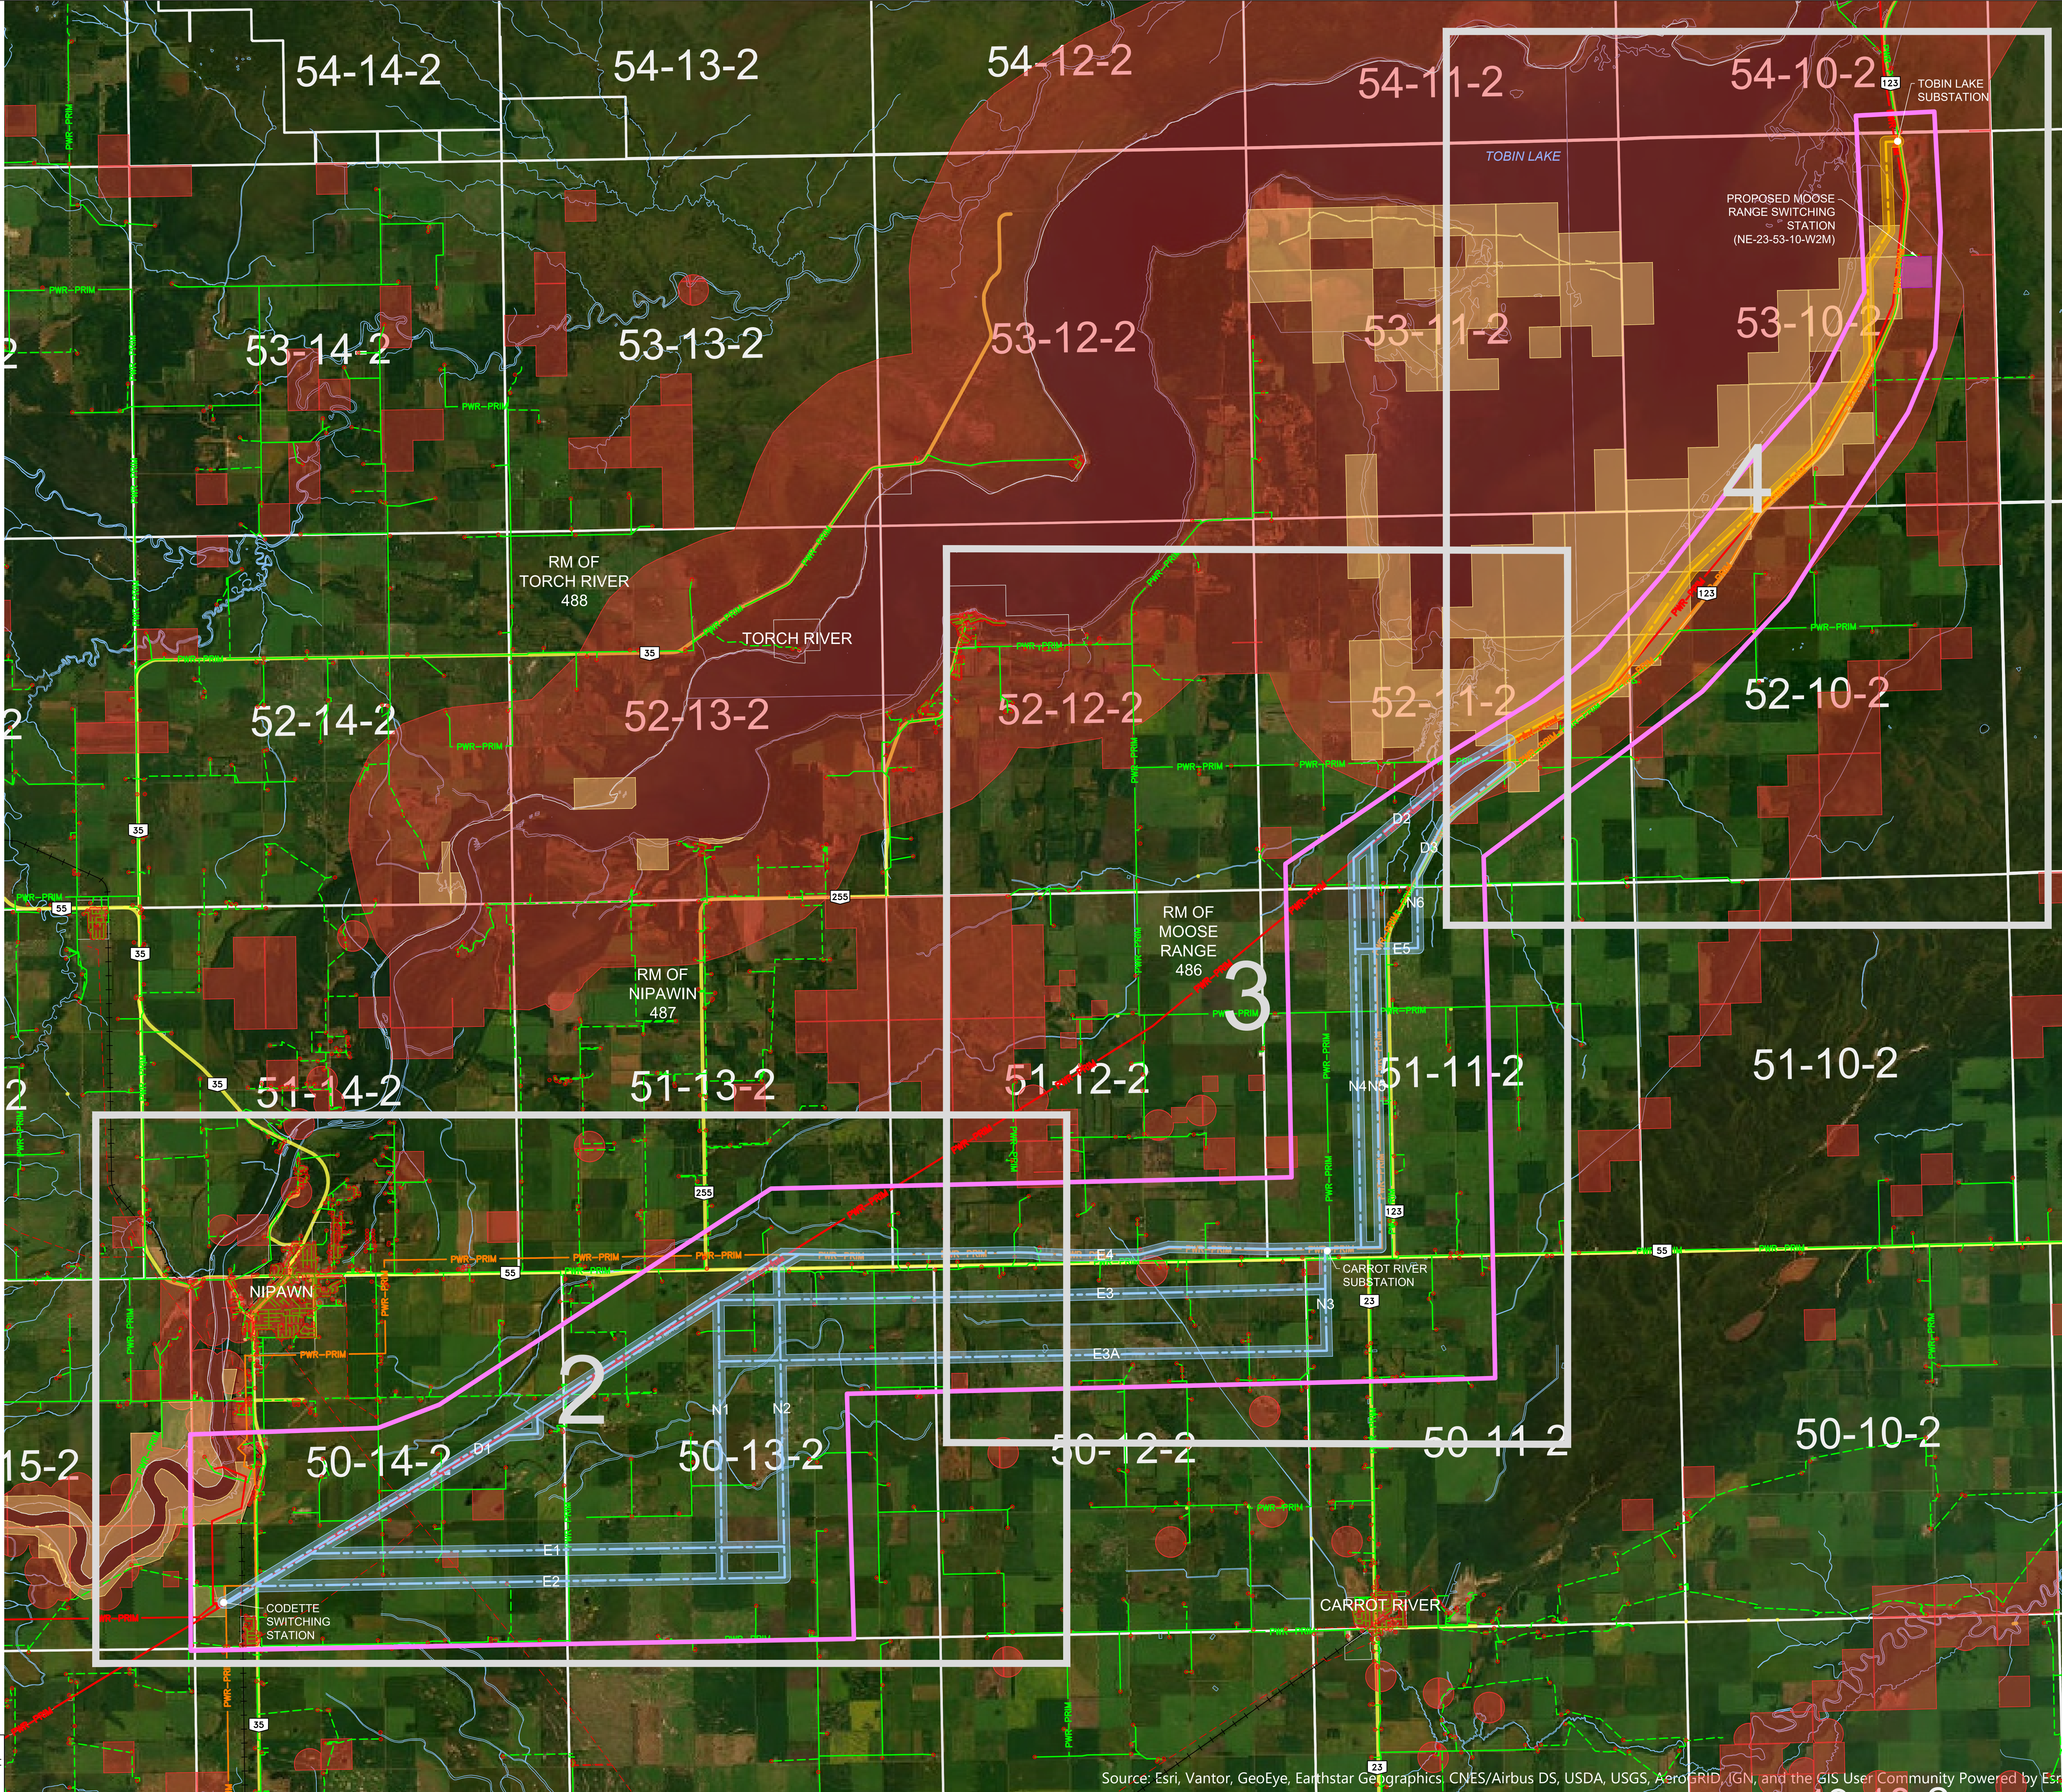

Source: Esri, Vantor, GeoEye, Earthstar Geographics, CNES/Airbus DS, USDA, USGS, AeroGRID, IGN, and the GIS User Community Powered by Esri

|                                                                    |                  |                                                                                                                                             |  |                                                                                                                                                                                                                                         |                                                                                                                                                                                                             |
|--------------------------------------------------------------------|------------------|---------------------------------------------------------------------------------------------------------------------------------------------|--|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
| DESIGNED BY<br>DRAWN BY<br>APPRO'D BY<br>SEALED BY<br>DATE (Y-M-D) | ENGINEERING SEAL | DRAFTING DEPT.<br>DRAWN BY: C. ISAAC<br>CHECKED BY: _____<br>DATE (Y-M-D): 2026-04-13                                                       |  |  <b>SaskPower</b> INTERNAL USE ONLY<br><br>PROPOSED 72kV<br>CE4-TBN<br>CODETTE TO TOBIN LAKE REBUILD<br>POTENTIAL ROUTES<br>L029 - CE4-TBN REBUILD | AUTOCAD SOURCE FILENAME:<br>T08-517.DWG<br>PLOT DATE: 2026-05-13 PAPER: E<br>PLOT TIME: 11:10 AM<br>PLOTTED BY: CSASAC<br>SCALE: 1:60,000<br>DRAWING No.<br><b>T08</b><br><b>517</b><br>SHEET 1 OF 4 REV. - |
|                                                                    |                  | DESIGN DEPT.<br>DESIGNED BY: C. TURRALDE<br>CHECKED BY: S. PILLIK<br>APPROVED BY: C. TURRALDE<br>SEALED BY: N/A<br>DATE (Y-M-D): 2026-04-13 |  |                                                                                                                                                                                                                                         |                                                                                                                                                                                                             |
|                                                                    |                  |                                                                                                                                             |  |                                                                                                                                                                                                                                         |                                                                                                                                                                                                             |
|                                                                    |                  |                                                                                                                                             |  |                                                                                                                                                                                                                                         |                                                                                                                                                                                                             |



|  |  |  |  |  |  |  |  |  |  |                               |  |                                      |
|--|--|--|--|--|--|--|--|--|--|-------------------------------|--|--------------------------------------|
|  |  |  |  |  |  |  |  |  |  | NOT FOR CONSTRUCTION          |  | AutoCAD                              |
|  |  |  |  |  |  |  |  |  |  | SaskPower INTERNAL USE ONLY   |  | AUTOCAD SOURCE FILENAME: T08_517.DWG |
|  |  |  |  |  |  |  |  |  |  | PROPOSED 72kV                 |  | PLOT DATE: 2026-05-13 PAPER: D       |
|  |  |  |  |  |  |  |  |  |  | CE4-TBN                       |  | PLOT TIME: 11:10 AM                  |
|  |  |  |  |  |  |  |  |  |  | CODETTE TO TOBIN LAKE REBUILD |  | PLOTTED BY: CISAC                    |
|  |  |  |  |  |  |  |  |  |  | POTENTIAL ROUTES              |  | SCALE: 1:30,000                      |
|  |  |  |  |  |  |  |  |  |  | L029 - CE4-TBN REBUILD        |  | DRAWING No. T08                      |
|  |  |  |  |  |  |  |  |  |  |                               |  | 517                                  |
|  |  |  |  |  |  |  |  |  |  |                               |  | SHEET 2 OF 4 REV. -                  |

|              |            |
|--------------|------------|
| DESIGNED BY  | C. ISAAC   |
| DRAWN BY     | C. ISAAC   |
| CHECKED BY   |            |
| DATE (Y-M-D) | 2026-04-13 |

|              |              |
|--------------|--------------|
| DESIGN DEPT. |              |
| DESIGNED BY  | C. ITURRALDE |
| CHECKED BY   | S. PILUK     |
| APPROVED BY  | C. ITURRALDE |
| SEALED BY    | N/A          |
| DATE (Y-M-D) | 2026-04-13   |

|                   |  |
|-------------------|--|
| ENGINEERING SEAL. |  |
|-------------------|--|

## OTHER UTILITIES


- EXISTING PIPELINE

# TOPOLOGY

- 
- RAILWAY
- ##
- HIGHWAY

## CONSTRAINTS

- ENVIRONMENTAL CONSTRAINTS  
HOUSE BUFFER – 46m

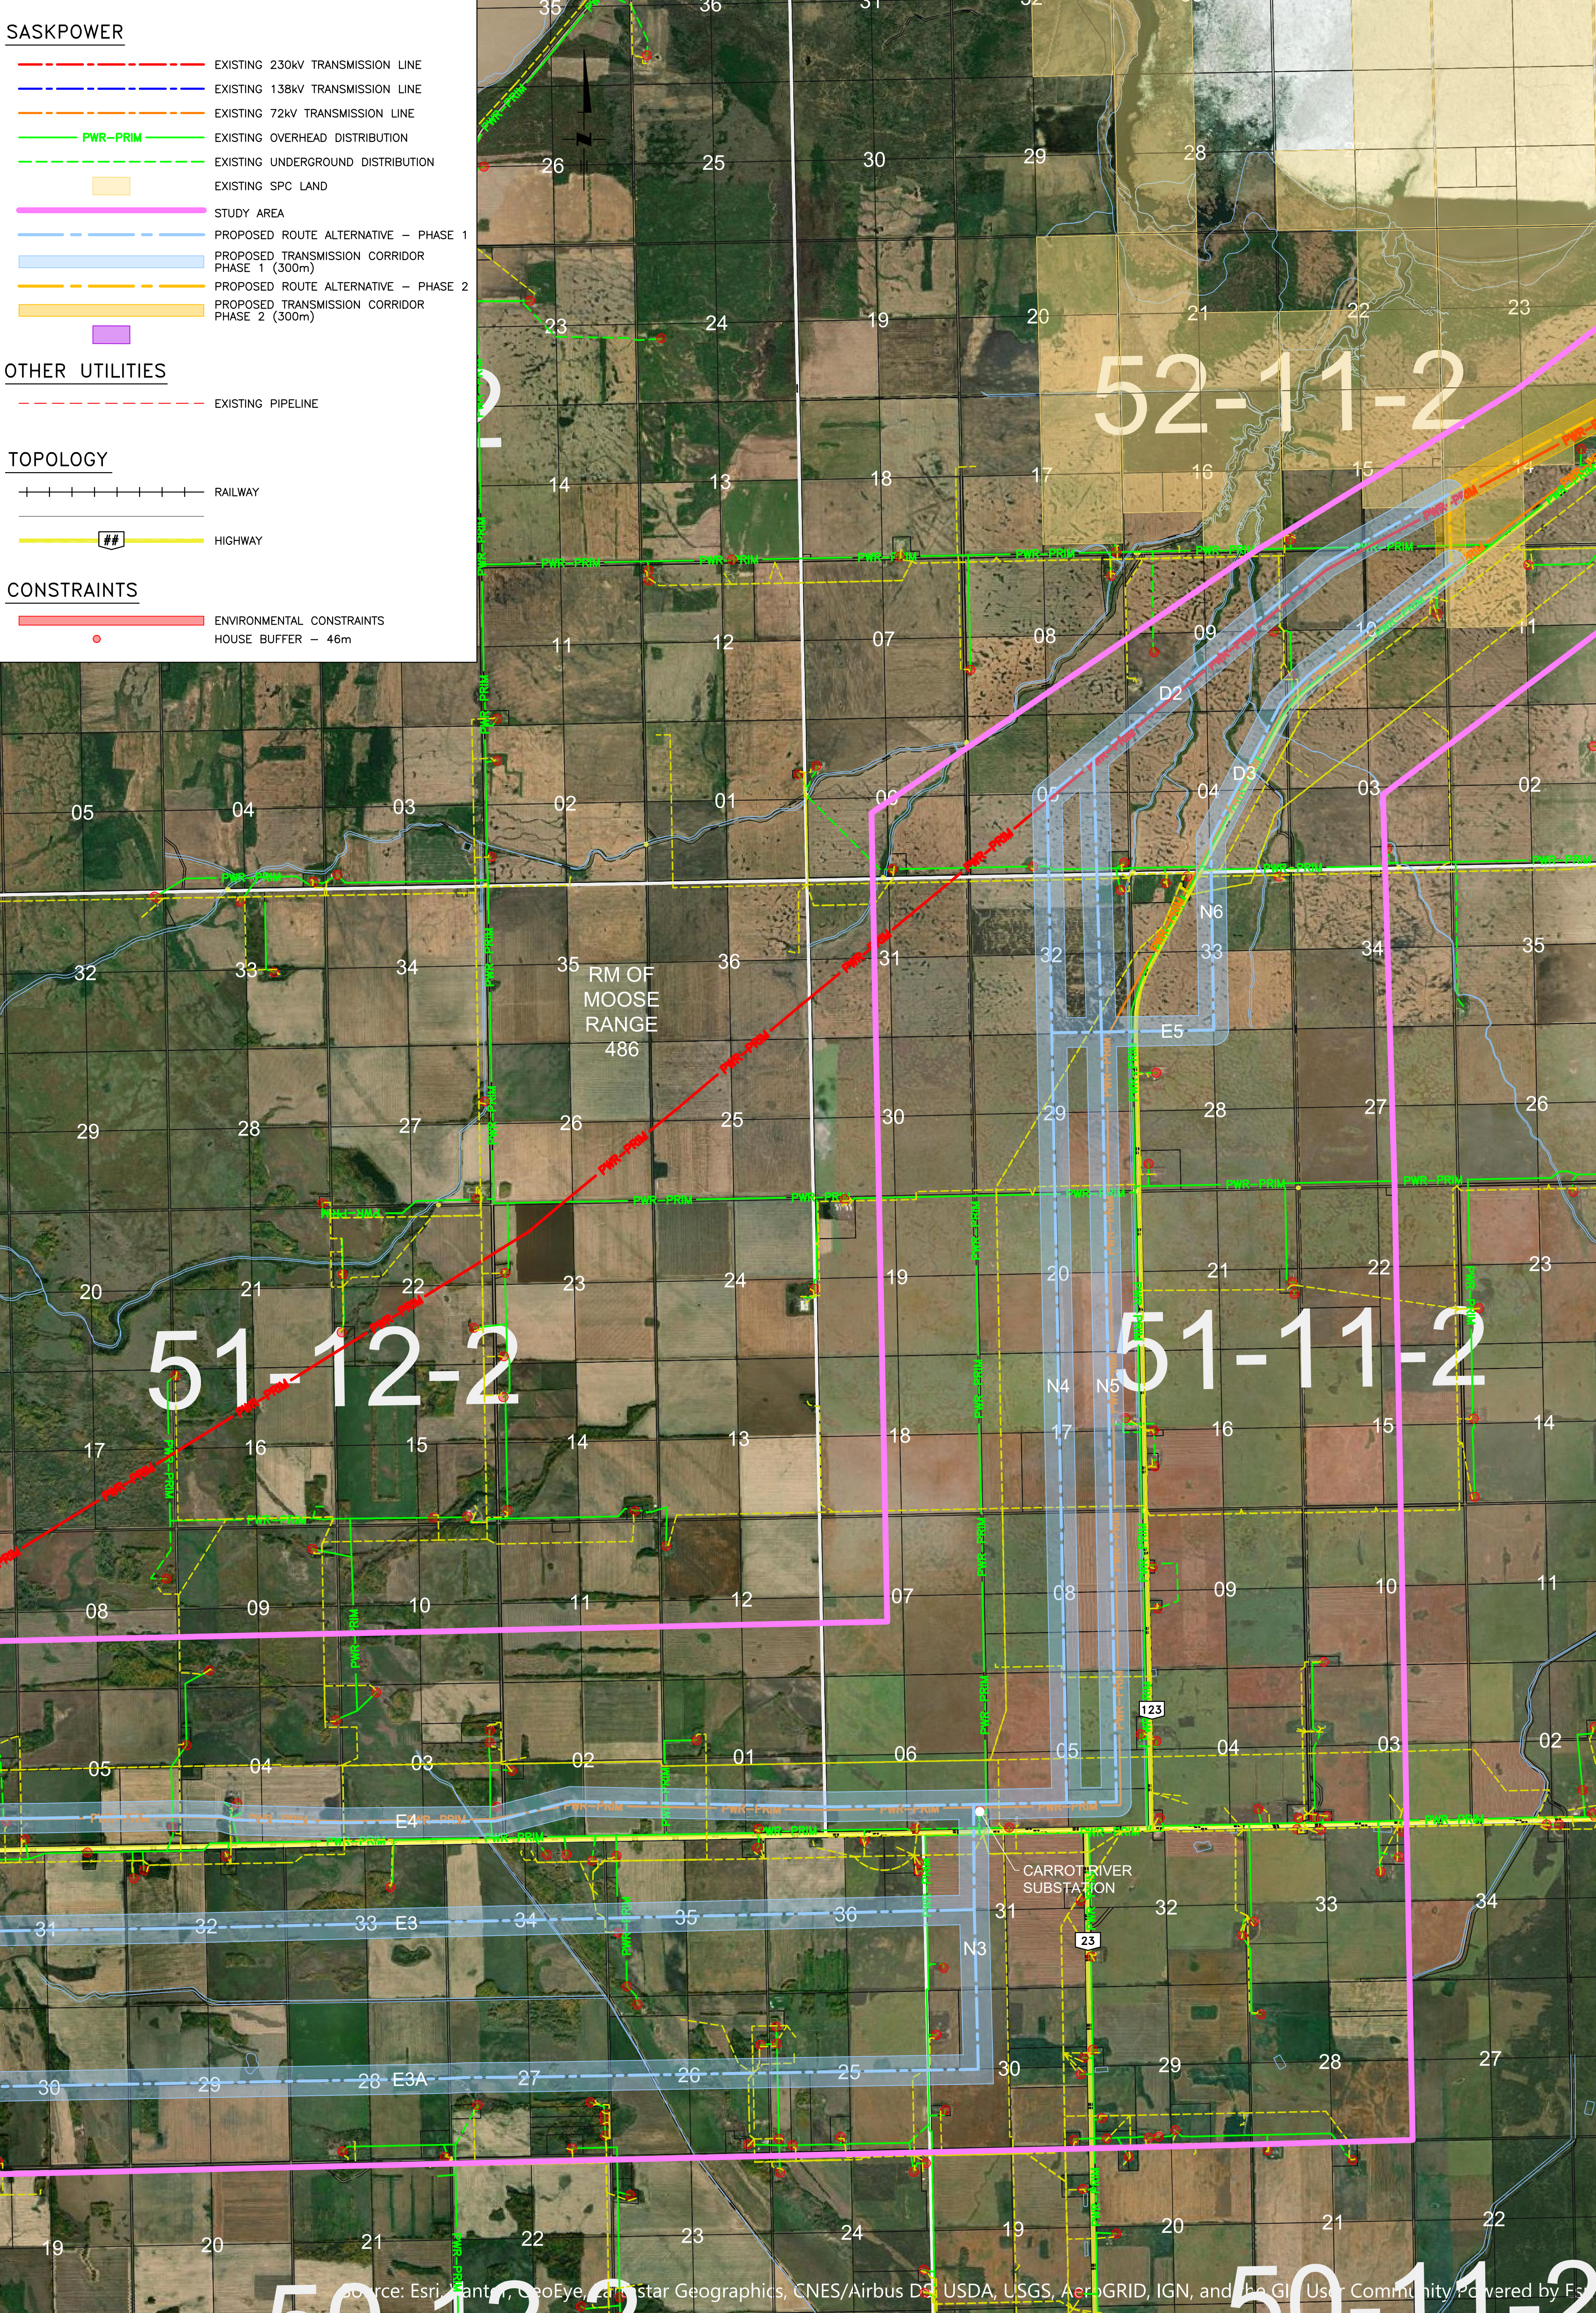

Source: Esri, DeLorme, GeoEye, "Swiss Topo", Intermap, IGN, and the GIS User Community/Powered by Esri

# AutoCAD

NOT FOR CONSTRUCTION



askPower

INTERNAL USE ONLY

PROPOSED 72kV

CE4-TBN

CODETTE TO TOBIN LAKE REBUILD

## POTENTIAL ROUTES

LO29 - CE4-IBN REBUILD

AUTOCAD SOURCE FILENAME:  
T08\_517.DWG

PLOT DATE: 2026-05-13 PAPER: D

PLOT TIME: 11:10 AM  
PLOTTED BY: CISAAC


|             |          |
|-------------|----------|
| SCALE:      | 1:30,000 |
| DRAWING No. |          |

T08

---

517

SHEET 3 OF 4      REV. —

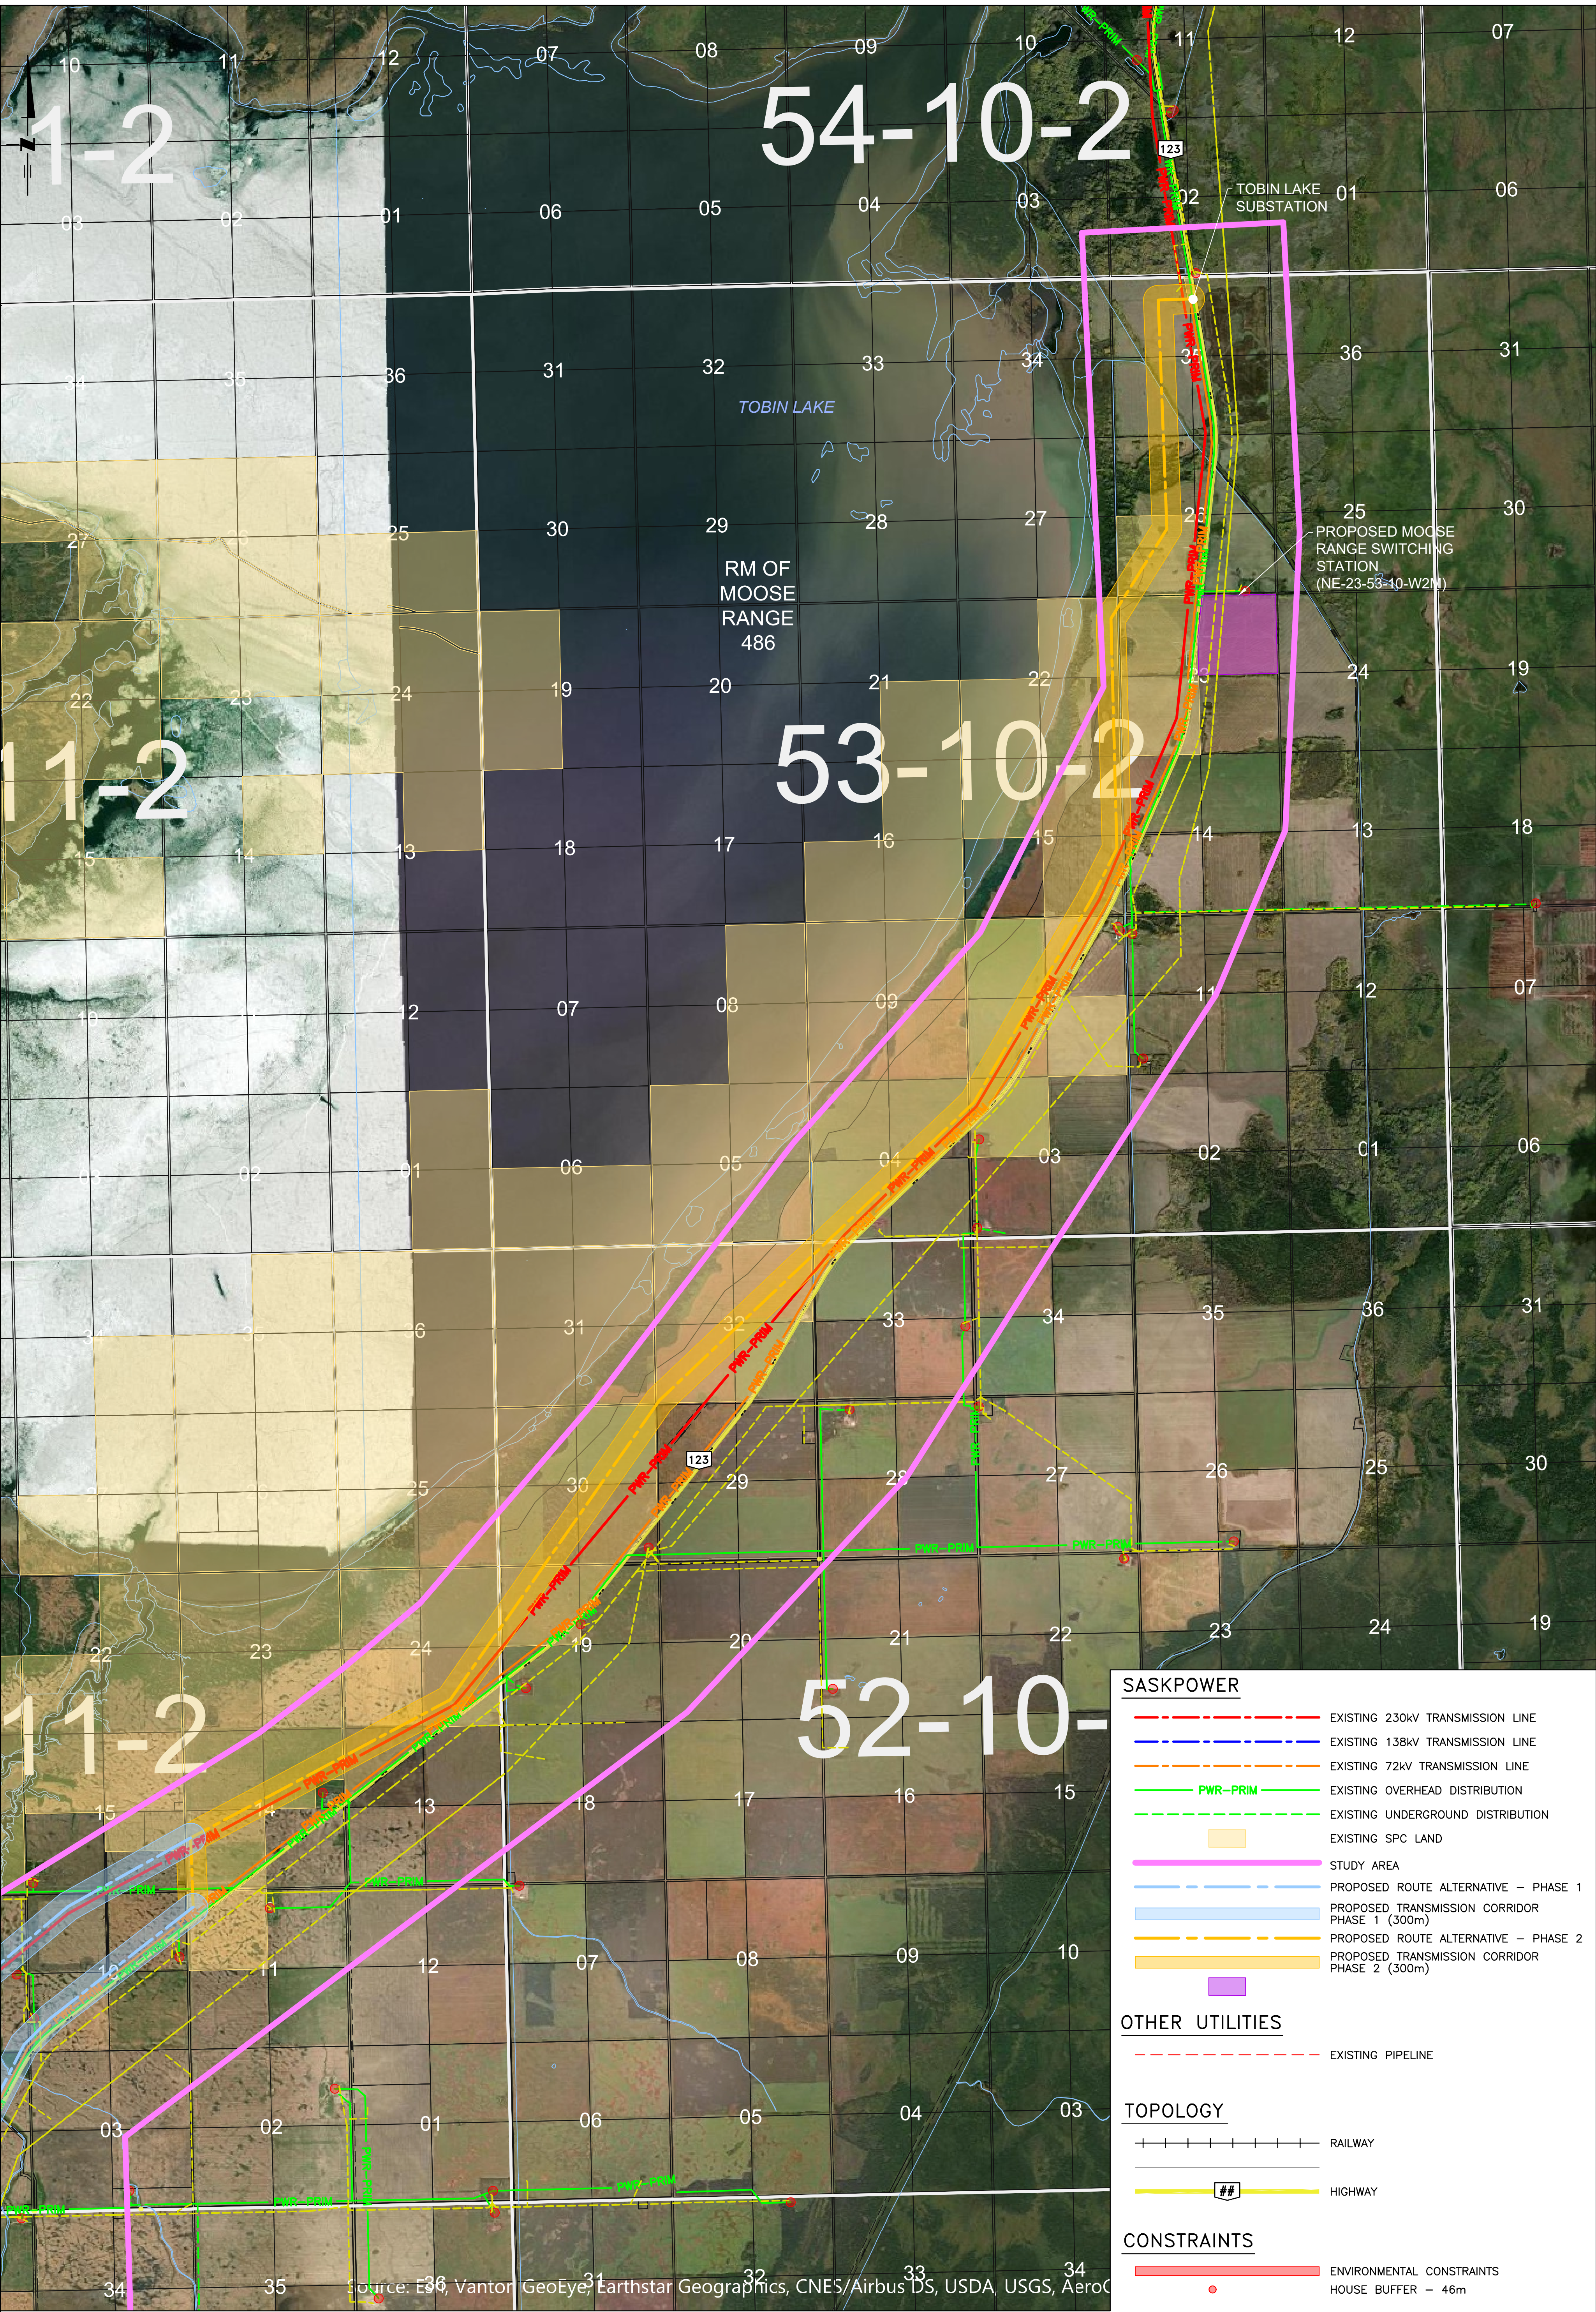

SASKPOWER

- EXISTING 230KV TRANSMISSION LINE
- EXISTING 138KV TRANSMISSION LINE
- EXISTING 72KV TRANSMISSION LINE
- PWR-PRIM EXISTING OVERHEAD DISTRIBUTION
- EXISTING UNDERGROUND DISTRIBUTION
- EXISTING SPC LAND
- STUDY AREA
- PROPOSED ROUTE ALTERNATIVE - PHASE 1
- PROPOSED TRANSMISSION CORRIDOR PHASE 1 (300m)
- PROPOSED ROUTE ALTERNATIVE - PHASE 2
- PROPOSED TRANSMISSION CORRIDOR PHASE 2 (300m)

OTHER UTILITIES

- EXISTING PIPELINE

TOPOLOGY

- RAILWAY
- HIGHWAY

CONSTRAINTS

- ENVIRONMENTAL CONSTRAINTS
- HOUSE BUFFER - 46m

NOT FOR CONSTRUCTION

AutoCAD

|  |  |  |                                                                   |                  |                                                                                       |                                                                                                                                        |                                                                                                                                                                                               |
|--|--|--|-------------------------------------------------------------------|------------------|---------------------------------------------------------------------------------------|----------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------------|
|  |  |  | DESIGNED BY<br>DRAWN BY<br>APPR'D BY<br>SEALED BY<br>DATE (Y-M-D) | ENGINEERING SEAL | DRAFTING DEPT.<br>DRAWN BY<br>CHECKED BY<br>DATE (Y-M-D)                              | SaskPower INTERNAL USE ONLY<br>PROPOSED 72kV<br>CE4-TBN<br>CODETTE TO TOBIN LAKE REBUILD<br>POTENTIAL ROUTES<br>L029 - CE4-TBN REBUILD | AUTOCAD SOURCE FILENAME:<br>T08_517.DWG<br>PLOT DATE: 2026-05-13 PAPER: D<br>PLOT TIME: 11:10 AM<br>PLOTTED BY: CISAAC<br>SCALE: 1:30,000<br>DRAWING No.<br>T08<br>517<br>SHEET 4 OF 4 REV. - |
|  |  |  |                                                                   |                  | DESIGN DEPT.<br>DESIGNED BY<br>CHECKED BY<br>APPROVED BY<br>SEALED BY<br>DATE (Y-M-D) |                                                                                                                                        |                                                                                                                                                                                               |